

PLANTA POTABILIZADORA PASTOR LOZANO

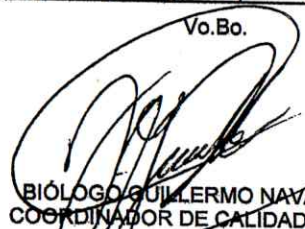
**ANÁLISIS FÍSICOQUÍMICOS
 AGUA POTABLE
 JULIO 2024**

RESULTADOS EN MG/LT

FECHA:	1	2	3	4	5	8	9	10	11	12	15	16	17	18	19	22	23	24	25	26	29	30	31	NOM-127/21	PROMEDIO
TURBIEDAD N.T.U.	4.0	3.9	3.7	4.0	3.5	4.0	3.6	3.5	4.0	3.7	3.9	4.0	3.6	3.8	4.0	3.8	3.6	3.8	4.0	3.5	4.0	3.9	4.0	4 NTU	3.8
P.H.	7.2	7.2	7.2	7.1	7.5	7.3	7.1	6.8	7.5	7.6	6.7	7.4	6.9	7.9	7.9	6.9	7.1	6.9	6.8	7.3	7.4	6.7	7.2	6,5-8,5	7.2
ALCALINIDAD TOTAL	100	93	96	97	85	122	99	100	90	117	130	128	122	94	98	92	99	93	90	90	80	103	96		101
DUREZA TOTAL	324	369	385	355	399	350	383	410	468	377	460	453	400	377	320	269	275	266	266	264	290	267	270	500 MG/LT	348
DUREZA DE CALCIO	214	200	220	238	210	240	237	220	279	256	327	317	287	227	202	162	146	150	146	115	153	115	126		208
DUREZA DE MAGNESIO	110	169	165	117	189	110	146	190	189	121	133	136	113	150	118	107	129	116	120	149	137	152	144		134
CLORUROS	217	233	246	229	257	231	223	250	252	236	308	296	291	278	240	164	144	170	160	150	163	150	170		220
CLORO RESIDUAL	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.4	1.2	1.5	1.5	1.5	1.5	1.2	1.5	1.5	1.5	1.5	1.1	1.5	1.5	1.5	0.2-1.5	1.5
SDT	647	698	706	772	985	990	962	965	950	955	990	995	954	895	776	546	519	742	674	655	635	608	596	1000 MG/LT	792
TEMPERATURA oC	24.7	24.2	27.1	27.5	29.4	24.3	26.9	27.0	25.0	26.0	27.8	29.3	28.3	28.6	28.4	24.9	26.6	24.6	26.5	25.8	25.5	28.6	28.2		26.7

AUTORIZÓ:

Edna Soto Lozano
 IQ. EDNA MARISSA SOTO LOZANO
 JEFA DE LABORATORIO

Vo.Bo.

 BIÓLOGO GUILLERMO NAVA LUJANO
 COORDINADOR DE CALIDAD DEL AGUA

05/08/2024
[Signature]